
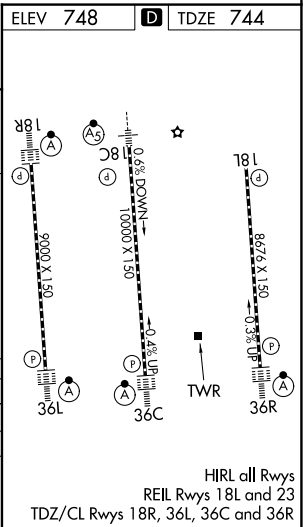
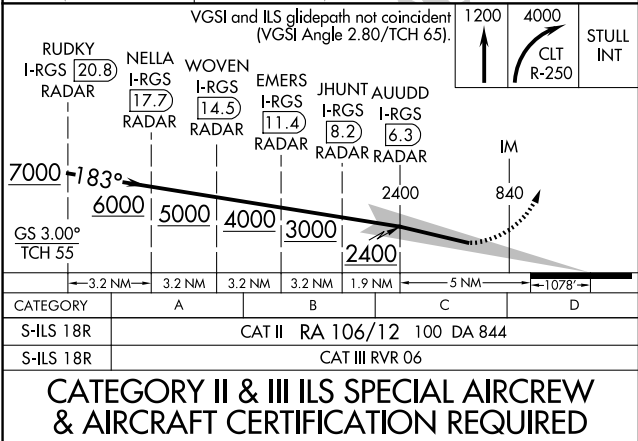


LOC/DME I-RGS	APP CRS	Rwy Ldg	9000
110.15	183°	TDZE	744
Chan 38(Y)		Apt Elev	748

ILS RWY 18R (CAT II & III)

CHARLOTTE/DOUGLAS INTL (CLT)

RADAR required for procedure entry. DME or RADAR required.		ALSIF-2	MISSED APPROACH: Climb to 1200 then climbing right turn to 4000 on CLT VOR/DME R-250 to STULL INT/CLT 13 DME and hold, continue climb-in-hold to 4000.
Simultaneous approach authorized.			
D-ATIS	CHARLOTTE APP CON	CHARLOTTE TOWER	GND CON
121.15	128.325 (001°-119°) 257.2 (180°-359°)	118.1 257.8 (Rwys 18L-36R)	121.8 348.6 (W)
	120.05 (120°-295°) 307.8 (360°-179°)	126.4 257.8 (Rwy 18C-36C)	121.9 348.6 (E)
	134.75 (296°-360°)	133.35 257.8 (Rwy 18R-36L)	

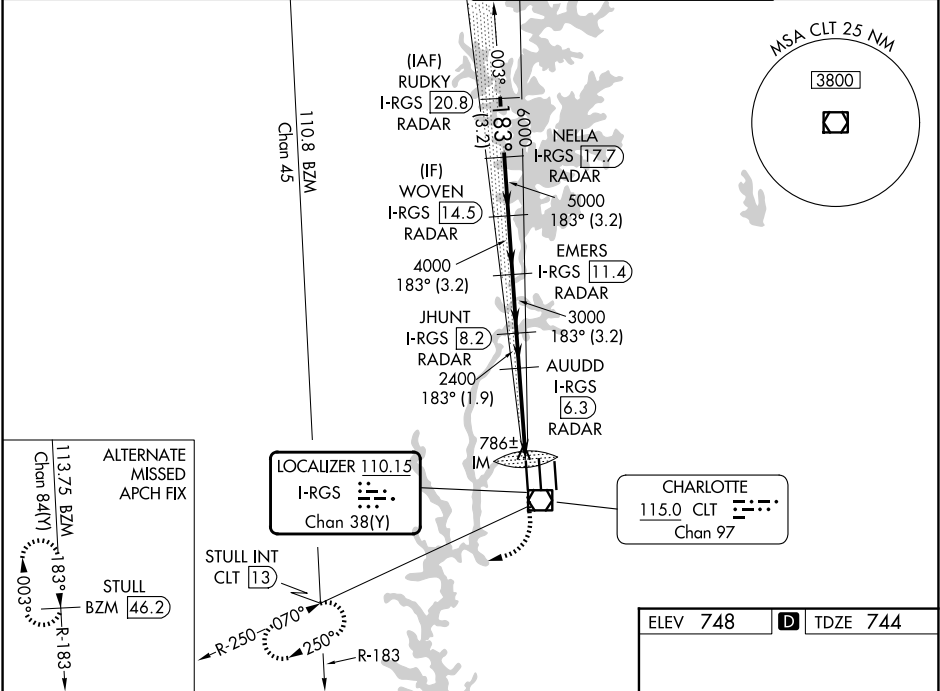

SE-2, 02 OCT 2025 to 30 OCT 2025

SE-2, 02 OCT 2025 to 30 OCT 2025