

APP CRS
079°

Rwy Ldg **12245**
TDZE **13**
Apt Elev **13**

RNAV (RNP) Z RWY 8L

DANIEL K INOUE INTL (HNL) (PHNL)


RNP AR APCH - GPS.

For uncompensated Baro-VNAV systems, procedure NA below 17°C or above 54°C. For inop ALS, increase RNP 0.15 DA all Cnts visibility to ¾ SM.

MALSR

MISSED APPROACH: Climb to 420 then climbing right turn to 3000 direct ALANA and hold.

D-ATIS 127.9 251.15	HCF APPROACH 118.3 269.0	HONOLULU TOWER 118.1 257.8 123.9 273.575 (8R/26L)	GND CON 121.9 348.6	CLNC DEL 121.4 281.4
-------------------------------	------------------------------------	---	-------------------------------	--------------------------------

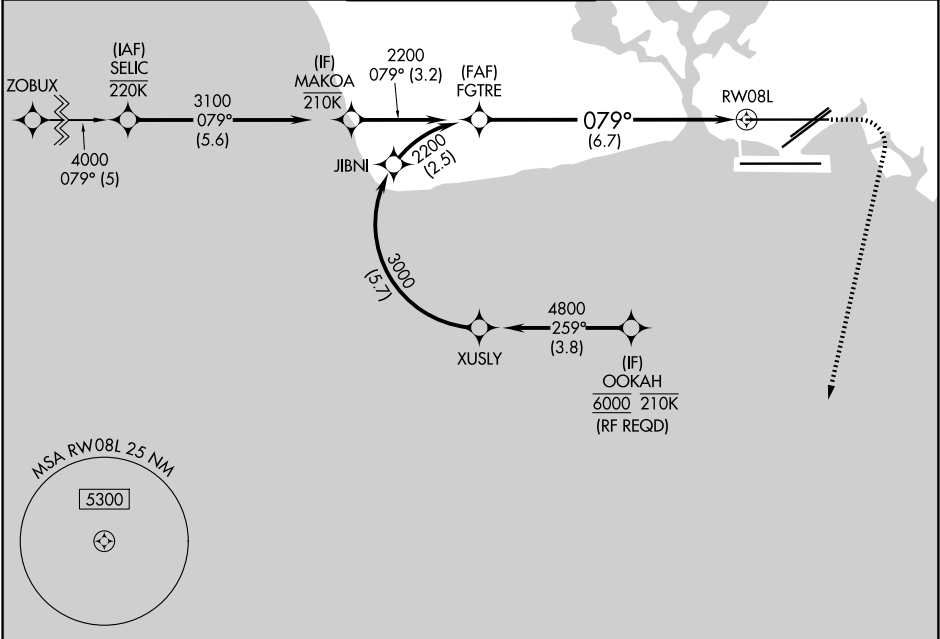

ELEV 13	D	TDZE 13
---------	----------	---------

MIRL Rwy 4L-22R
REIL Rwys 4L, 8R, 22L, 22R, and 26R
HIRL Rwys 4R-22L, 8L-26R, and 8R-26L

ALANA 420 3000 ALANA ↑  △ 3.51° 1.71° 4 NM				
See planview for multiple IF locations.				
MAKOA 3100 079° 2200 GP 3.00° TCH 56 3.2 NM 6.7 NM RW08L VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 73). FGTRE 2200				
CATEGORY	A	B	C	D
RNP 0.15 DA	285-½ 272 (300-½)			
RNP 0.30 DA	347-½ 334 (400-½)			
AUTHORIZATION REQUIRED				