


|         |          |      |
|---------|----------|------|
| APP CRS | Rwy Ldg  | 6995 |
| 024°    | TDZE     | 55   |
|         | Apt Elev | 55   |

RNAV (RNP) Z RWY 2

KAHALUI (OGG)(PHOG)

|                                                                                                                                                                                                      |       |                                                       |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------|-------------------------------------------------------|
| RNP AR APCH - GPS.                                                                                                                                                                                   | MALSR | MISSED APPROACH: Climb to 3000 direct KRANE and hold. |
| ▼ For uncompensated Baro-VNAV systems, procedure NA below 14°C or above 54° C. When local altimeter setting not received, procedure NA. For inop ALS, increase RNP 0.30 all Cats visibility to ½ SM. |       |                                                       |

|       |                                    |                      |             |        |
|-------|------------------------------------|----------------------|-------------|--------|
| ATIS  | HCF APPROACH                       | MAUI TOWER★          | GND CON     | UNICOM |
| 128.6 | 120.2 322.4 (N)<br>119.5 225.4 (S) | 118.7 (CTAF) 0 279.6 | 121.9 279.6 | 122.95 |

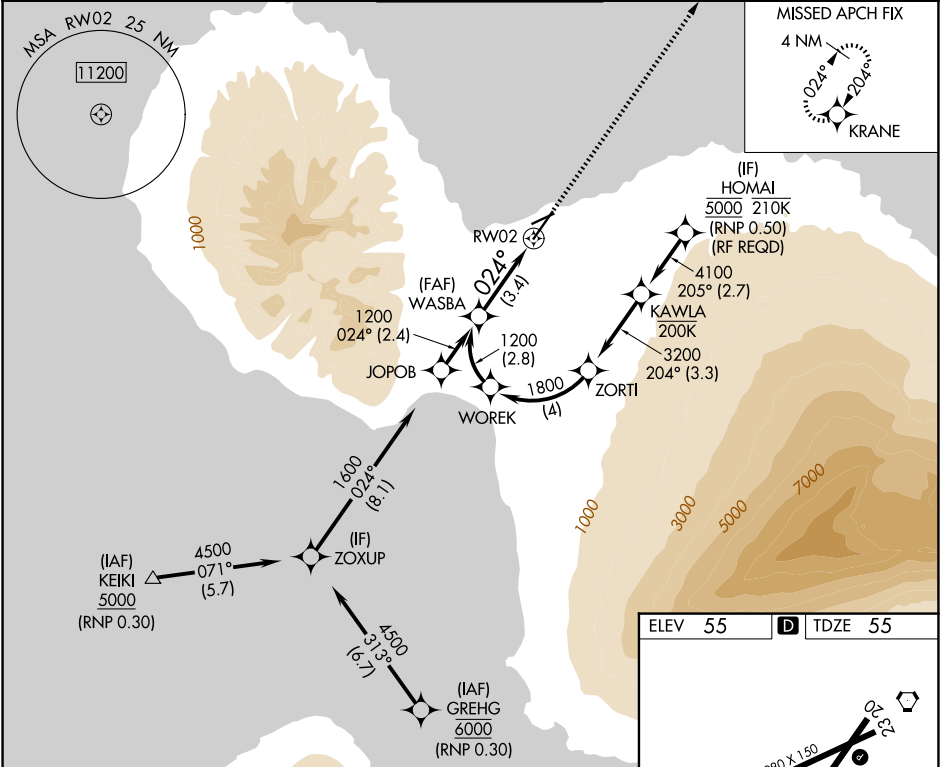

|                        |  |                                                                     |   |      |       |
|------------------------|--|---------------------------------------------------------------------|---|------|-------|
| WASBA                  |  | VGSi and RNAV glidepath not coincident<br>(VGSi Angle 3.00/TCH 77). |   | 3000 | KRANE |
| 1200                   |  | See planview for multiple IF locations.                             |   |      |       |
| 1200                   |  | 024°                                                                |   | RW02 |       |
| GP 3.00°<br>TCH 62     |  |                                                                     |   |      |       |
| CATEGORY               |  | A                                                                   | B | C    | D     |
| RNP 0.30 DA            |  | 394-1/2 339 (400-1/2)                                               |   |      |       |
| AUTHORIZATION REQUIRED |  |                                                                     |   |      |       |