

LOC/DME I-GSP

109.3
Chan 30

APP CRS

038°

Rwy Ldg

11001

TDZE

947

Apt Elev

964

ILS RWY 4 (SA CAT I)

GREENVILLE SPARTANBURG INTL (GSP)


DME required.

Requires specific OPSPEC, MSPEC, or LOA approval and use of HUD to DH.
Procedure NA when control tower closed.

ALSF-2

MISSED APPROACH: Climb to 3000 then right turn direct SPA VORTAC and hold.

ATIS 134.25	GREER APP CON★ 118.8 270.275	GREER TOWER★ 120.1(CTAF) 0 251.15	GND CON 121.9	UNICOM 122.95
----------------	---------------------------------	--------------------------------------	------------------	------------------

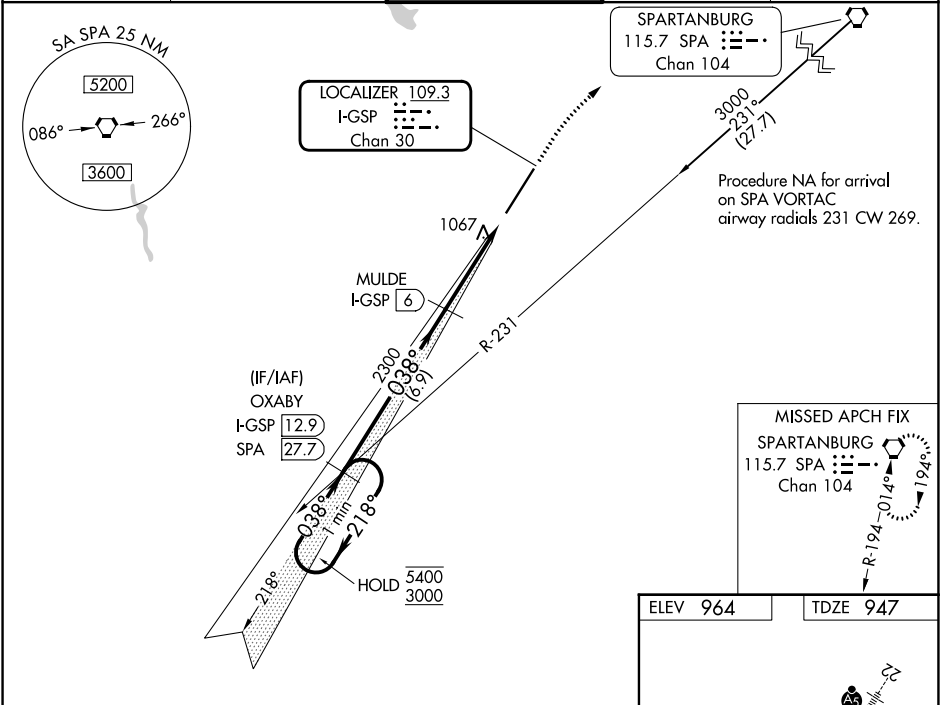

One Minute Holding Pattern

OXABY INT I-GSP 12.9

MULDE I-GSP (6)

3000

SPA

5400

3000

218°

038°

038°

2300

2300

GS 3.00°

TCH 55

6.9 NM

4.1 NM

1010'

CATEGORY	A	B	C	D
S-ILS 4	RA 258/14 150 DA 1097			

SA CATEGORY I ILS - SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED

RCLS Rwy 22

HIRL Rwy 4-22

TDZL/RCLS Rwy 4