
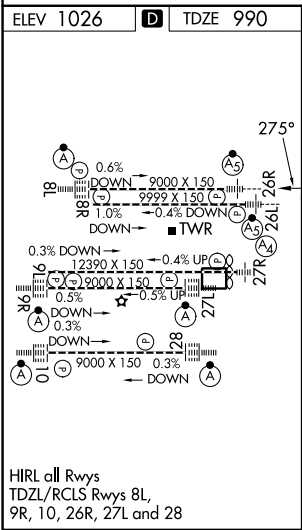


APP CRS	Rwy Ldg	8500
275°	TDZE	990
	Apt Elev	1026

RNAV (RNP) Z RWY 26R
HARTSFIELD/JACKSON ATLANTA INTL (ATL)

▼ For uncompensated Baro-VNAV systems, procedure NA below -8°C (18°F) or above 54°C (130°F). GPS required. Simultaneous approach authorized. Arrival from BROOX NA during simultaneous triple approaches.							MALSR 	MISSED APPROACH: Climb to 1500 then climbing right turn to 3500 direct TROYS and hold.	
D-ATIS 119.65	ATLANTA APP CON	ATLANTA TOWER					GND CON		
		8L-26R	8R-26L	9L-27R	9R-27L	10-28	ALL RWYS	(8L-26R,8R-26L) (9L-27R,9R-27L) 10-28	ALL RWYS
	134.725 379.9	119.1	125.325	123.85	119.3	119.5	254.4	121.9	121.75 121.65 254.4

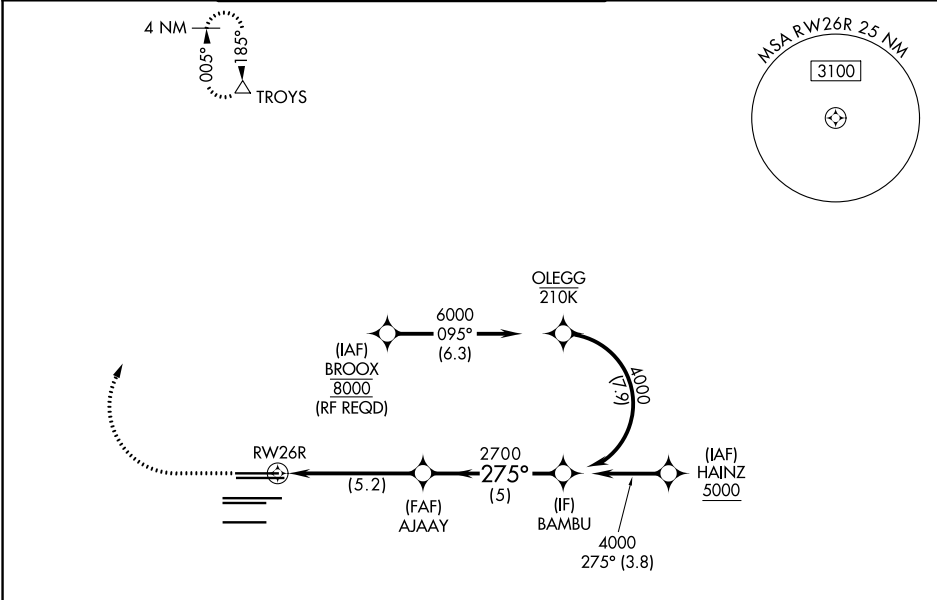

1500 ↑		3500 ↶		TROYS △		VGSi and RNAV glidepath not coincident (VGSi Angle 3.00/TCH 69).	
RW26R		AJAAY 2700		BAMBU 4000		GP 3.00° TCH 55	
5.2 NM		5 NM					
CATEGORY	A	B	C	D			
RNP 0.30 DA	1402/45		412 (400-1)				
AUTHORIZATION REQUIRED							