RNAV (RNP) Z RWY 4R

DANIEL K INOUYE INTL (HNL) (PHNL)

APP CRS	Rwy Ldg	8950
042°	TDZE	9
	Apt Elev	13


RNP AR APCH.

For uncompensated Baro-VNAV systems, procedure NA below 17°C or above 54°C. For inop ALS, increase RNP 0.30 Cat A visibility to ¾ SM and Cat B to ⅞ SM.


MALSR

MISSED APPROACH: Climb to 580 then climbing right turn to 3000 direct ALANA and hold.


D-ATIS	HCF APPROACH	HONOLULU TOWER	GND CON
127.9 251.15	118.3 269.0	118.1 257.8 123.9 273.575 (8R/26L)	121.9 348.6

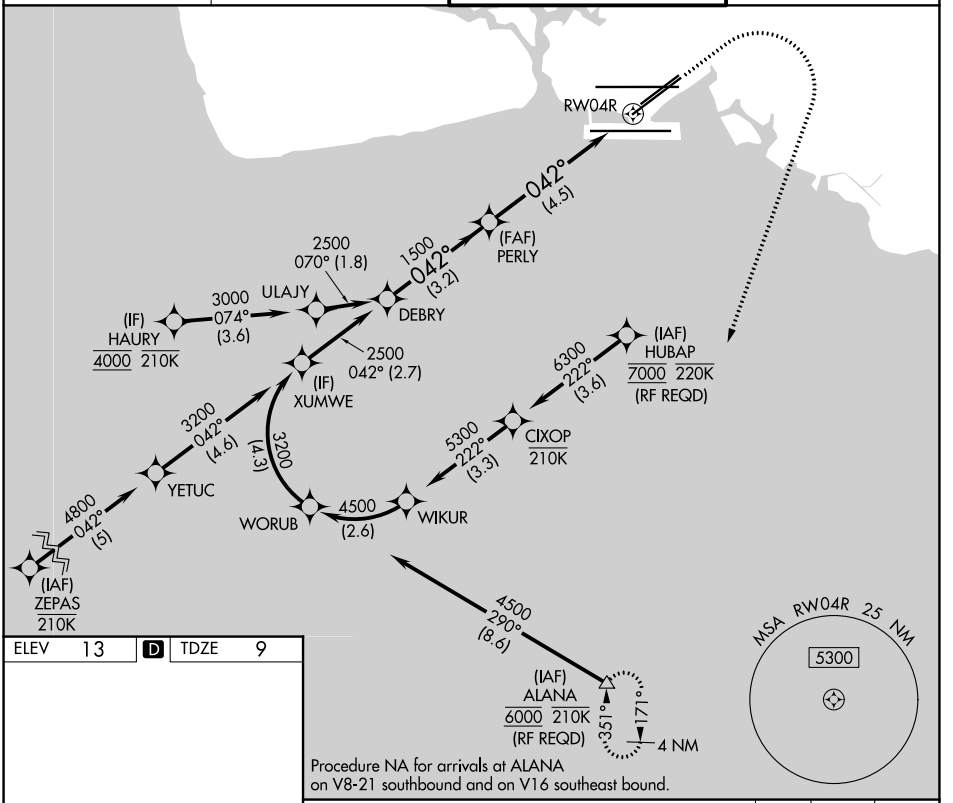

ELEV 13 | D | TDZE 9

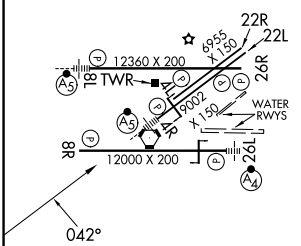

MIRL Rwy 4L-22R
REIL Rwys 4L, 8R, 22L, 22R, and 26R
HIRL Rwys 4R-22L, 8L-26R, and 8R-26L

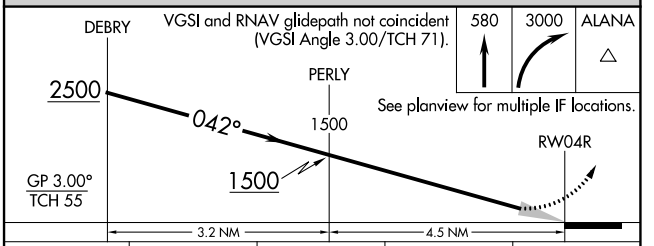

CATEGORY	A	B	C	D
RNP 0.30 DA	259-½ 250 (300-½)	277-½ 268 (300-½)	432-¾	423 (500-¾)

AUTHORIZATION REQUIRED

PAC, 29 OCT 2026 to 24 DEC 2026
PAC, 29 OCT 2026 to 24 DEC 2026